





Innovation & Quality

www.votatec.ca

4ft Glass T5 Tube With Plastic Coating (UL TYPE A)

PVT5-4FT-24WAKS-26K

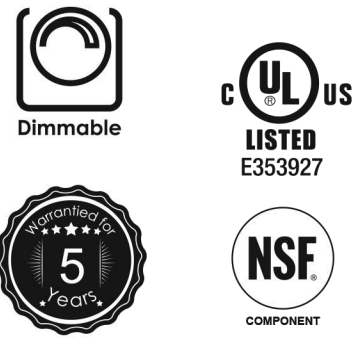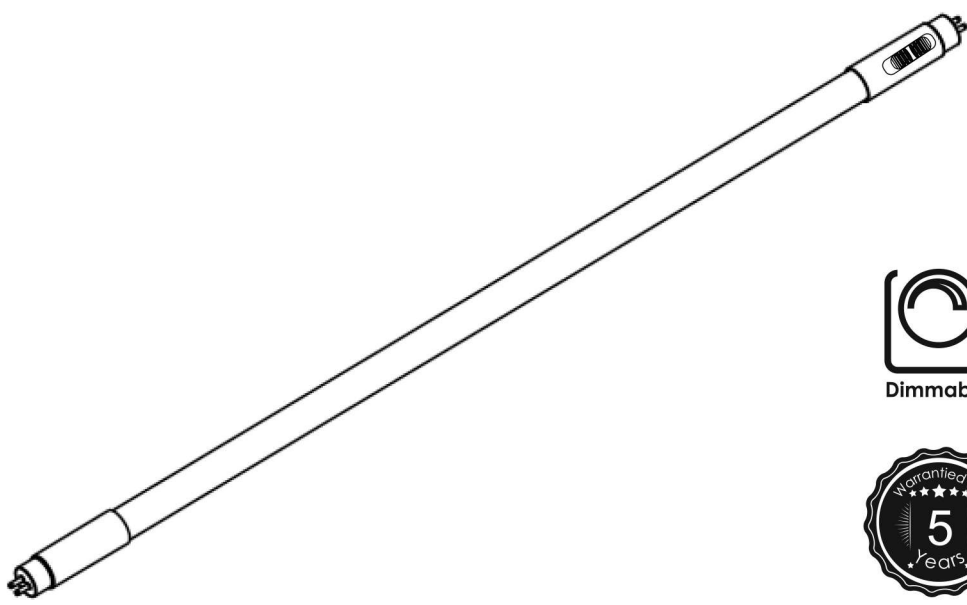

Please keep this Quick Installation Guide for future reference.

Modifications to the product void the Warranty.


Suitable to replace fluorescent lamps as specified on the product label.

Model Number / Numéro de modèle	Minimum Lamp Compartment Dimensions That Use Max 4 Lamp / Dimensions minimales du compartiment de la lampe qui utilise 4 lampes au maximum	Spacing between tube lamps center to center	Lamp Quantity / Quantité de lampes
PVT5-4FT-24WAKS-26K	[Length x Width x Height] / [Longueur x Largeur x Hauteur] 48 x 22.56 x 2.56 in (1218 x 573 x 65 mm)	4.33 in (110mm)	4

MARKINGS/WARNING:

- a. TO PREVENT ELECTRICAL SHOCK, TURN OFF POWER BEFORE INSPECTION, REMOVAL, OR INSTALLATION.
- b. CAUTION – RISK OF ELECTRIC SHOCK. Do not use if outer lamp envelope is damaged or broken.
- c. CAUTION RISK OF FIRE –IF THE LAMP OR LUMINAIRE EXHIBITS UNDESIRABLE OPERATION (BUZZING, FLICKERKING, ARCING, ETC.), IMMEDIATELY TURN OFF POWER, REMOVE LAMP FROM LUMINAIRE AND CONTACT MANUFACTURER.
- d. DO NOT INSTALL THIS LAMP IN A PRE-HEAT BALLASTED LUMINAIRE.
- e. THIS LAMP ONLY OPERATES ON ELECTRONIC BALLASTS. IF LAMP DOES NOT LIGHT WHEN THE LUMINAIRE IS ENERGIZED, REMOVE LAMP FROM LUMINAIRE AND CONTACT QUALIFIED ELECTRICIAN.
- f. THIS DEVICE IS NOT INTENDED FOR USE WITH EMERGENCY EXIT LIGHTS.
- g. SUITABLE FOR USE IN DRY AND DAMP LOCATIONS.
- h. SUITABLE FOR USE IN TOTALLY ENCLOSED RECESSED FIXTURES.
- i. TYPE A LAMP - Intended for direct substitution of a fluorescent lamp and operating from the integral ballast without any modifications to the fluorescent luminaire.

TYPE A-Assembly introduction:

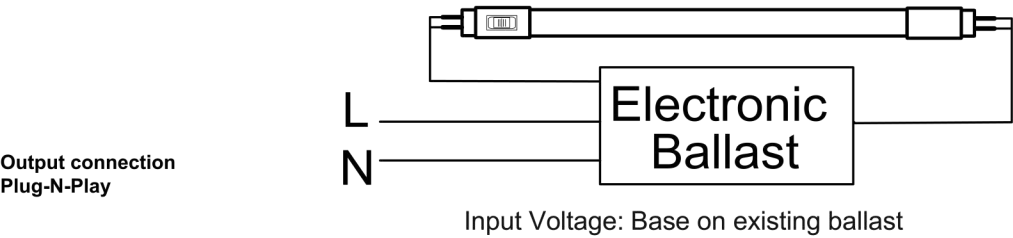


nnovation & Quality

www.votatec.ca

4ft Glass T5 Tube With Plastic Coating (UL TYPE A)

PVT5-4FT-24WAKS-26K

TYPE A-Installation Guide:

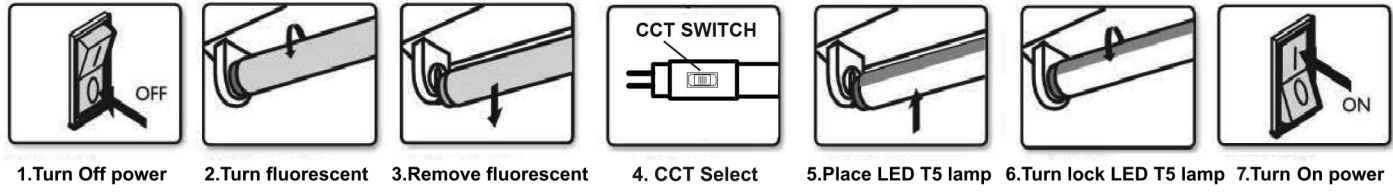

Instructions

- 1. Switch-off power to the luminaire.
- 2. Remove diffuser (if one is present).
- 3. Remove the existing fluorescent lamps from the luminaire.
- 4. Remove the ballast cover and identify if the ballast is compatible. (See warnings and compatible list)
- 5. Select the color temperature through the CCT switch on the LED lamp base.
 - Using the color (CCT) selector switch on the base, select the desired color temperature (3500K,4000K,5000K,or 6500K)
 - To prevent damage to lamp, lamp must not be energized when color (CCT) selector switch is changed.
- 6. Reinstall the ballast cover.
- 7. Install the LED tube lamp.
- 8. Reinstall diffuser (if removed in step 2).
- 9. Switch on power to the luminaire.

Note: Before installation, please check specifications for the most current ballast compatibility list. Do not install the lamp with incompatible ballast.

WARNING –RISK OF FIRE: Tubes must be installed with the end cap marks in correct alignment with the lamp holder sockets as show below. Please ensure the mark is aligned with lamp holder socket as shown below.

